


Appendix A

UCSD Library - Amenities Survey (April 2020)

May 21, 2020 2:31 PM PDT

Q1 - What amenity(ies) does Geisel need more of [choose up to 3]?

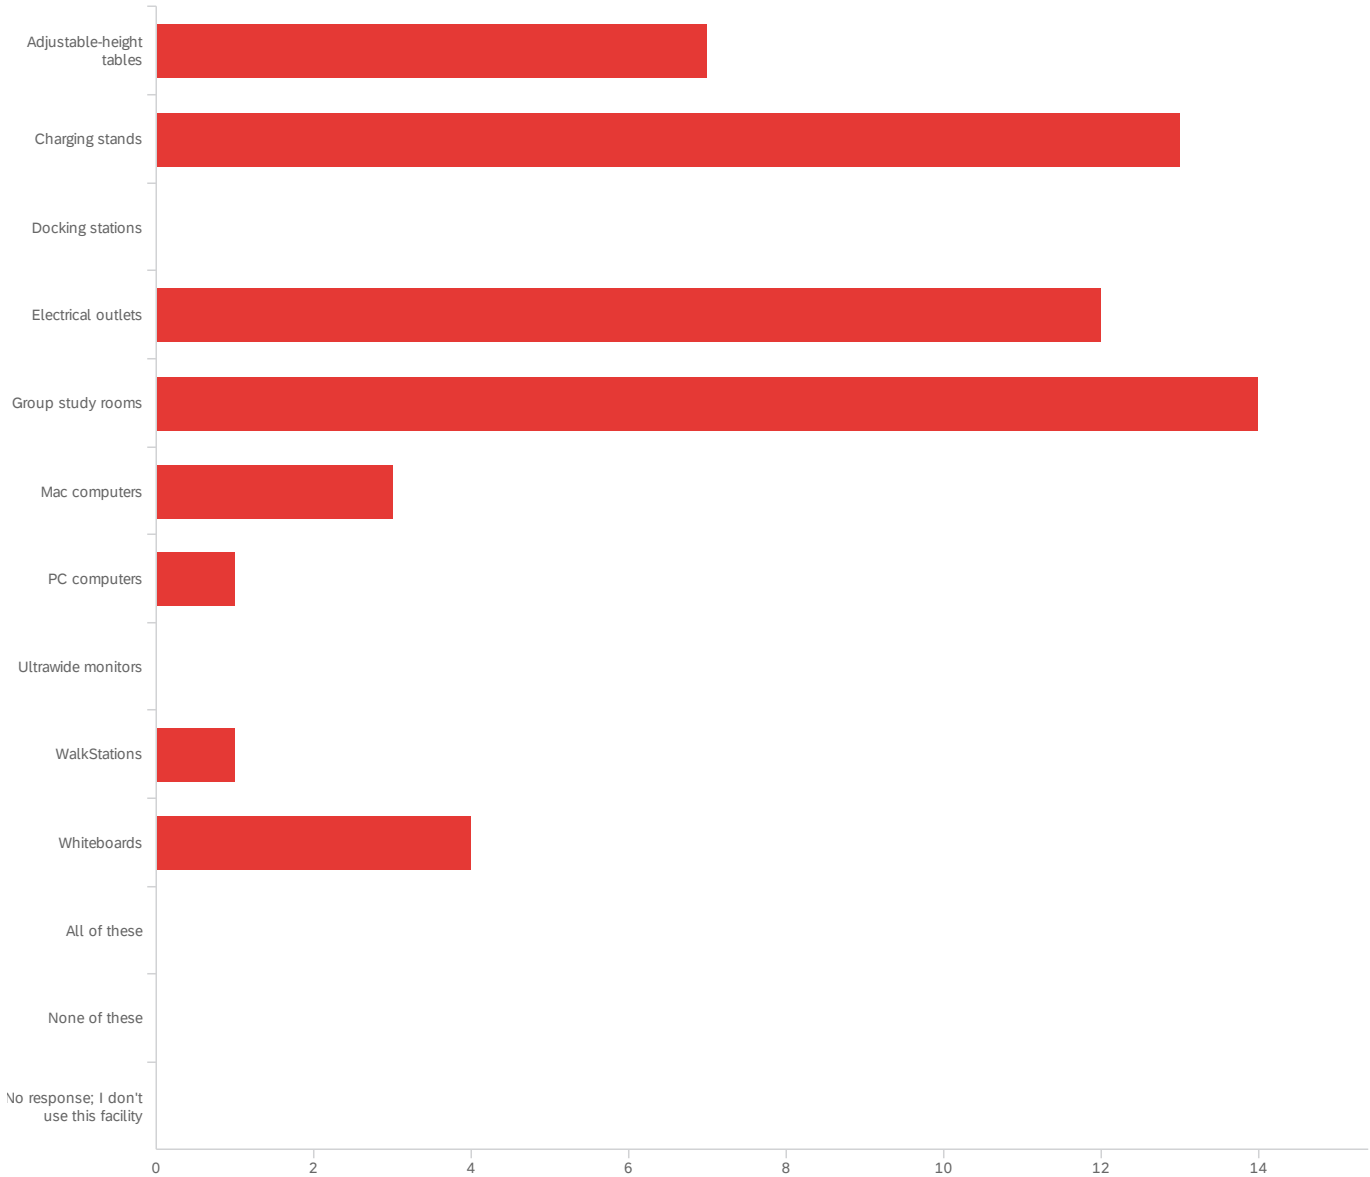


#	Field	Choice Count
1	Adjustable-height tables	12.73% 7
2	Charging stands	23.64% 13
3	Docking stations	0.00% 0
4	Electrical outlets	21.82% 12

#	Field	Choice Count
5	Group study rooms	25.45% 14
6	Mac computers	5.45% 3
7	PC computers	1.82% 1
8	Ultrawide monitors	0.00% 0
9	WalkStations	1.82% 1
10	Whiteboards	7.27% 4
11	All of these	0.00% 0
12	None of these	0.00% 0
13	No response; I don't use this facility	0.00% 0
		55

Showing rows 1 - 14 of 14

Q2 - What amenity(ies) does the Biomedical Library Building (BLB) need more of

[choose up to 3]?

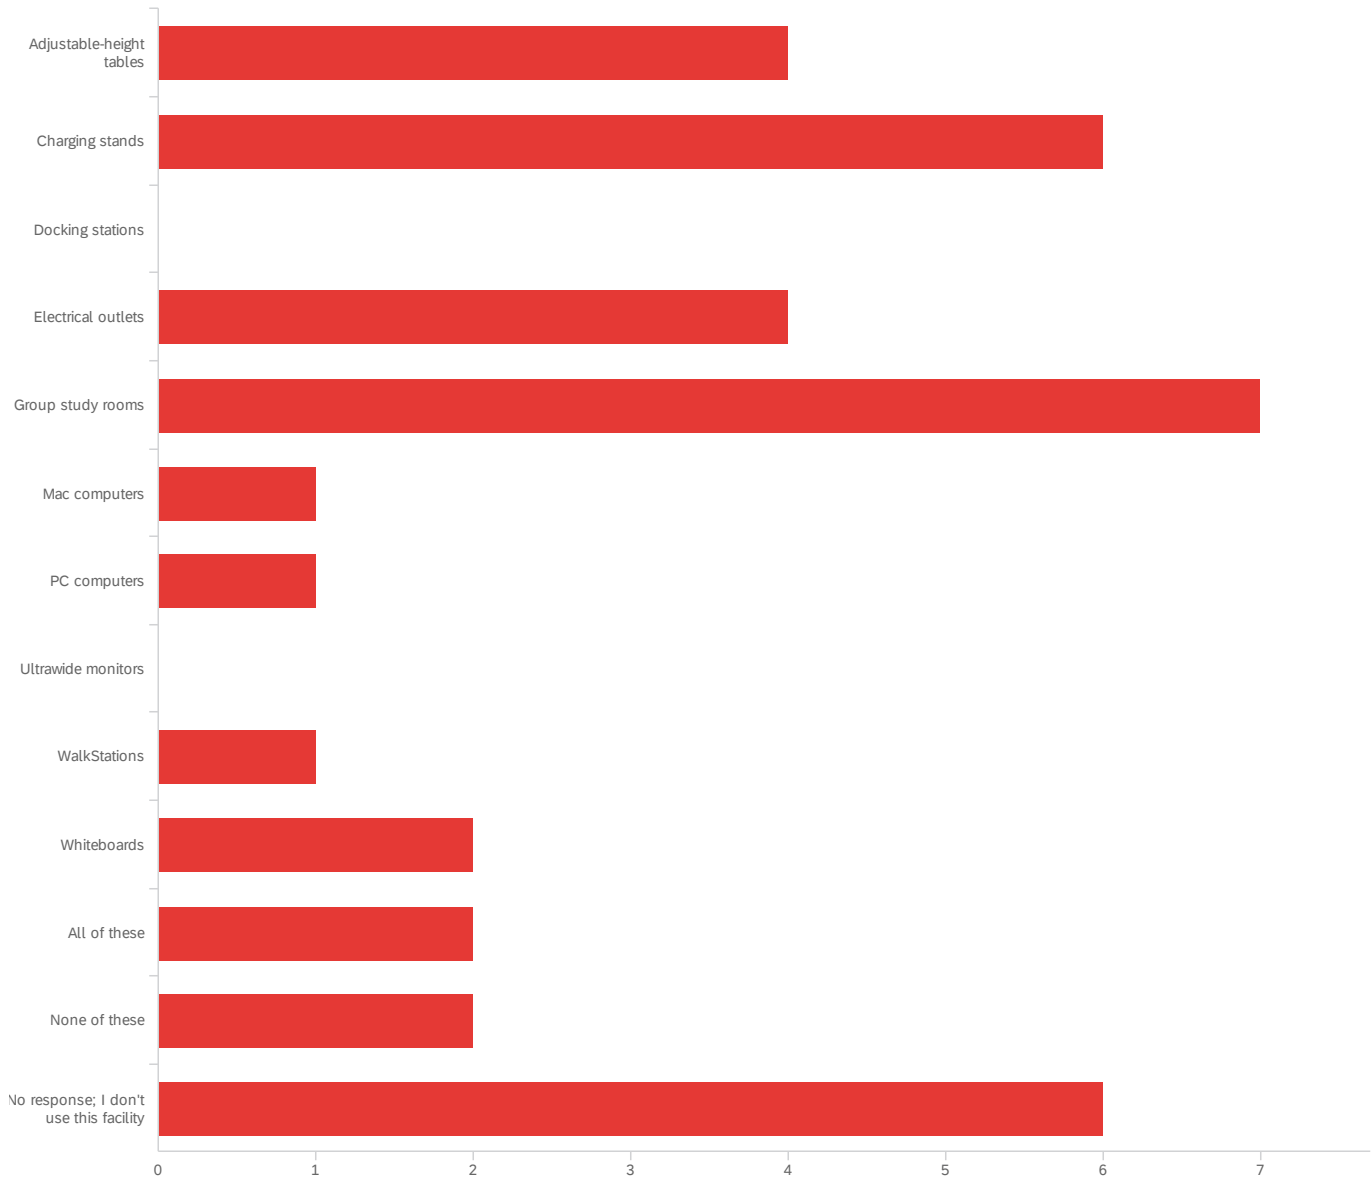

#	Field	Choice Count
1	Adjustable-height tables	11.11% 4
2	Charging stands	16.67% 6
3	Docking stations	0.00% 0
4	Electrical outlets	11.11% 4
5	Group study rooms	19.44% 7

#	Field	Choice Count
6	Mac computers	2.78% 1
7	PC computers	2.78% 1
8	Ultrawide monitors	0.00% 0
9	WalkStations	2.78% 1
10	Whiteboards	5.56% 2
11	All of these	5.56% 2
12	None of these	5.56% 2
13	No response; I don't use this facility	16.67% 6
		36

Showing rows 1 - 14 of 14